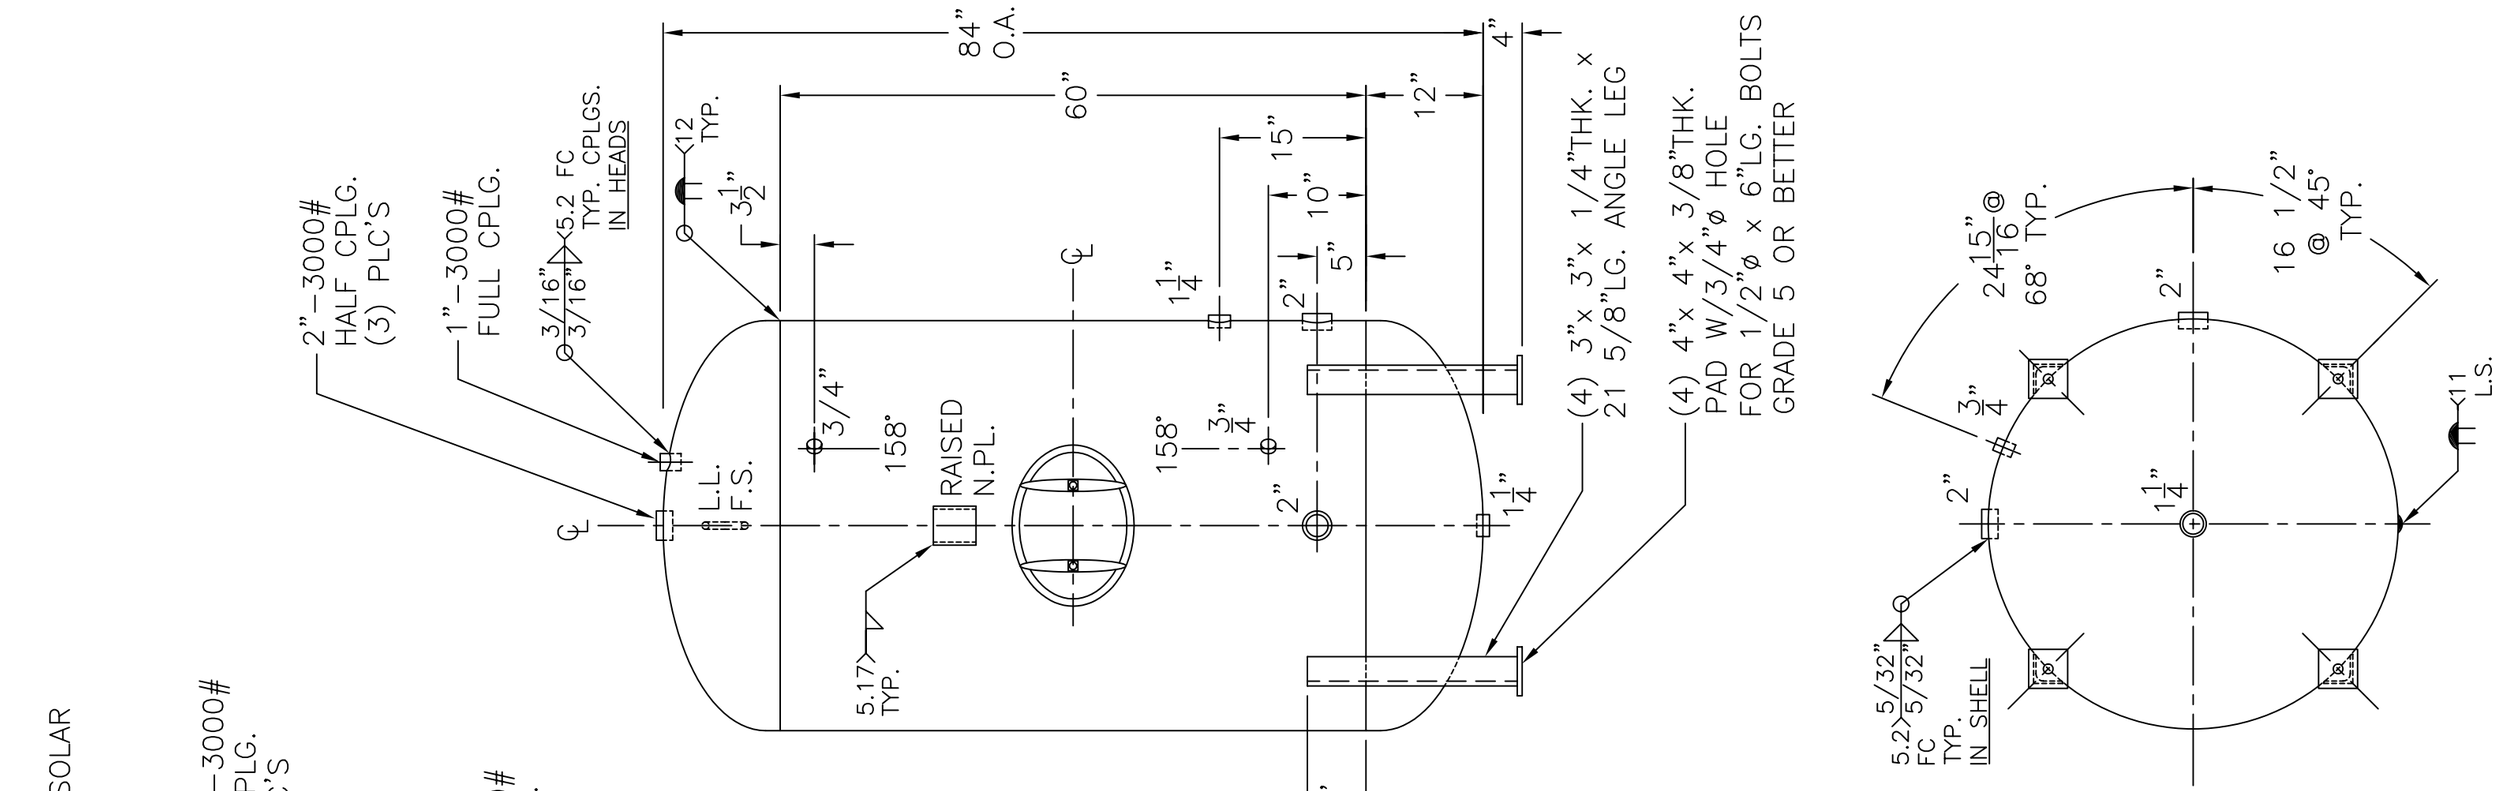

4) 4-1-04 PROOF TEST.
3) EXTEND ALL CPLG'S 5/8" INSIDE.
2) HYDRO @ 240 PSIG.
NOTE. 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.

SHELL / HEADS	.205" SA-455 2:1 S.E.
	JOGGLE
	.189 OFFSET - BROWN STRIPE
	.175" SA-414-G
M.A.W.P.	160 PSIG. @ 210 °F
ASME. SECTION IV	2004 ADD 2006
X-RAY:	RT-NO / H.L.W.
GALLONS: 462	WT. 1450 LBS.
SERIAL NO.	
N.B.	

CS-42-462-V	REV. 1-19-07
	DATE: 10-10-90
FOR: HANSON STANDARD	
VERT. HOT WATER TANK	
82.8 SQ. FT. SURFACE AREA. THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT.	
INSIDE: CEMENT LINED	
OUTSIDE: PRIME	
(431) LEG ZONE: 4-15 KM.	
CAD "B" UNDER "STD"-SERIES	
BY: J.G.	SCALE: 3/4"=12"

ROY E. HANSON JR. MFG.
1600 E. WASHINGTON BLVD.
LOS ANGELES, CA 90021