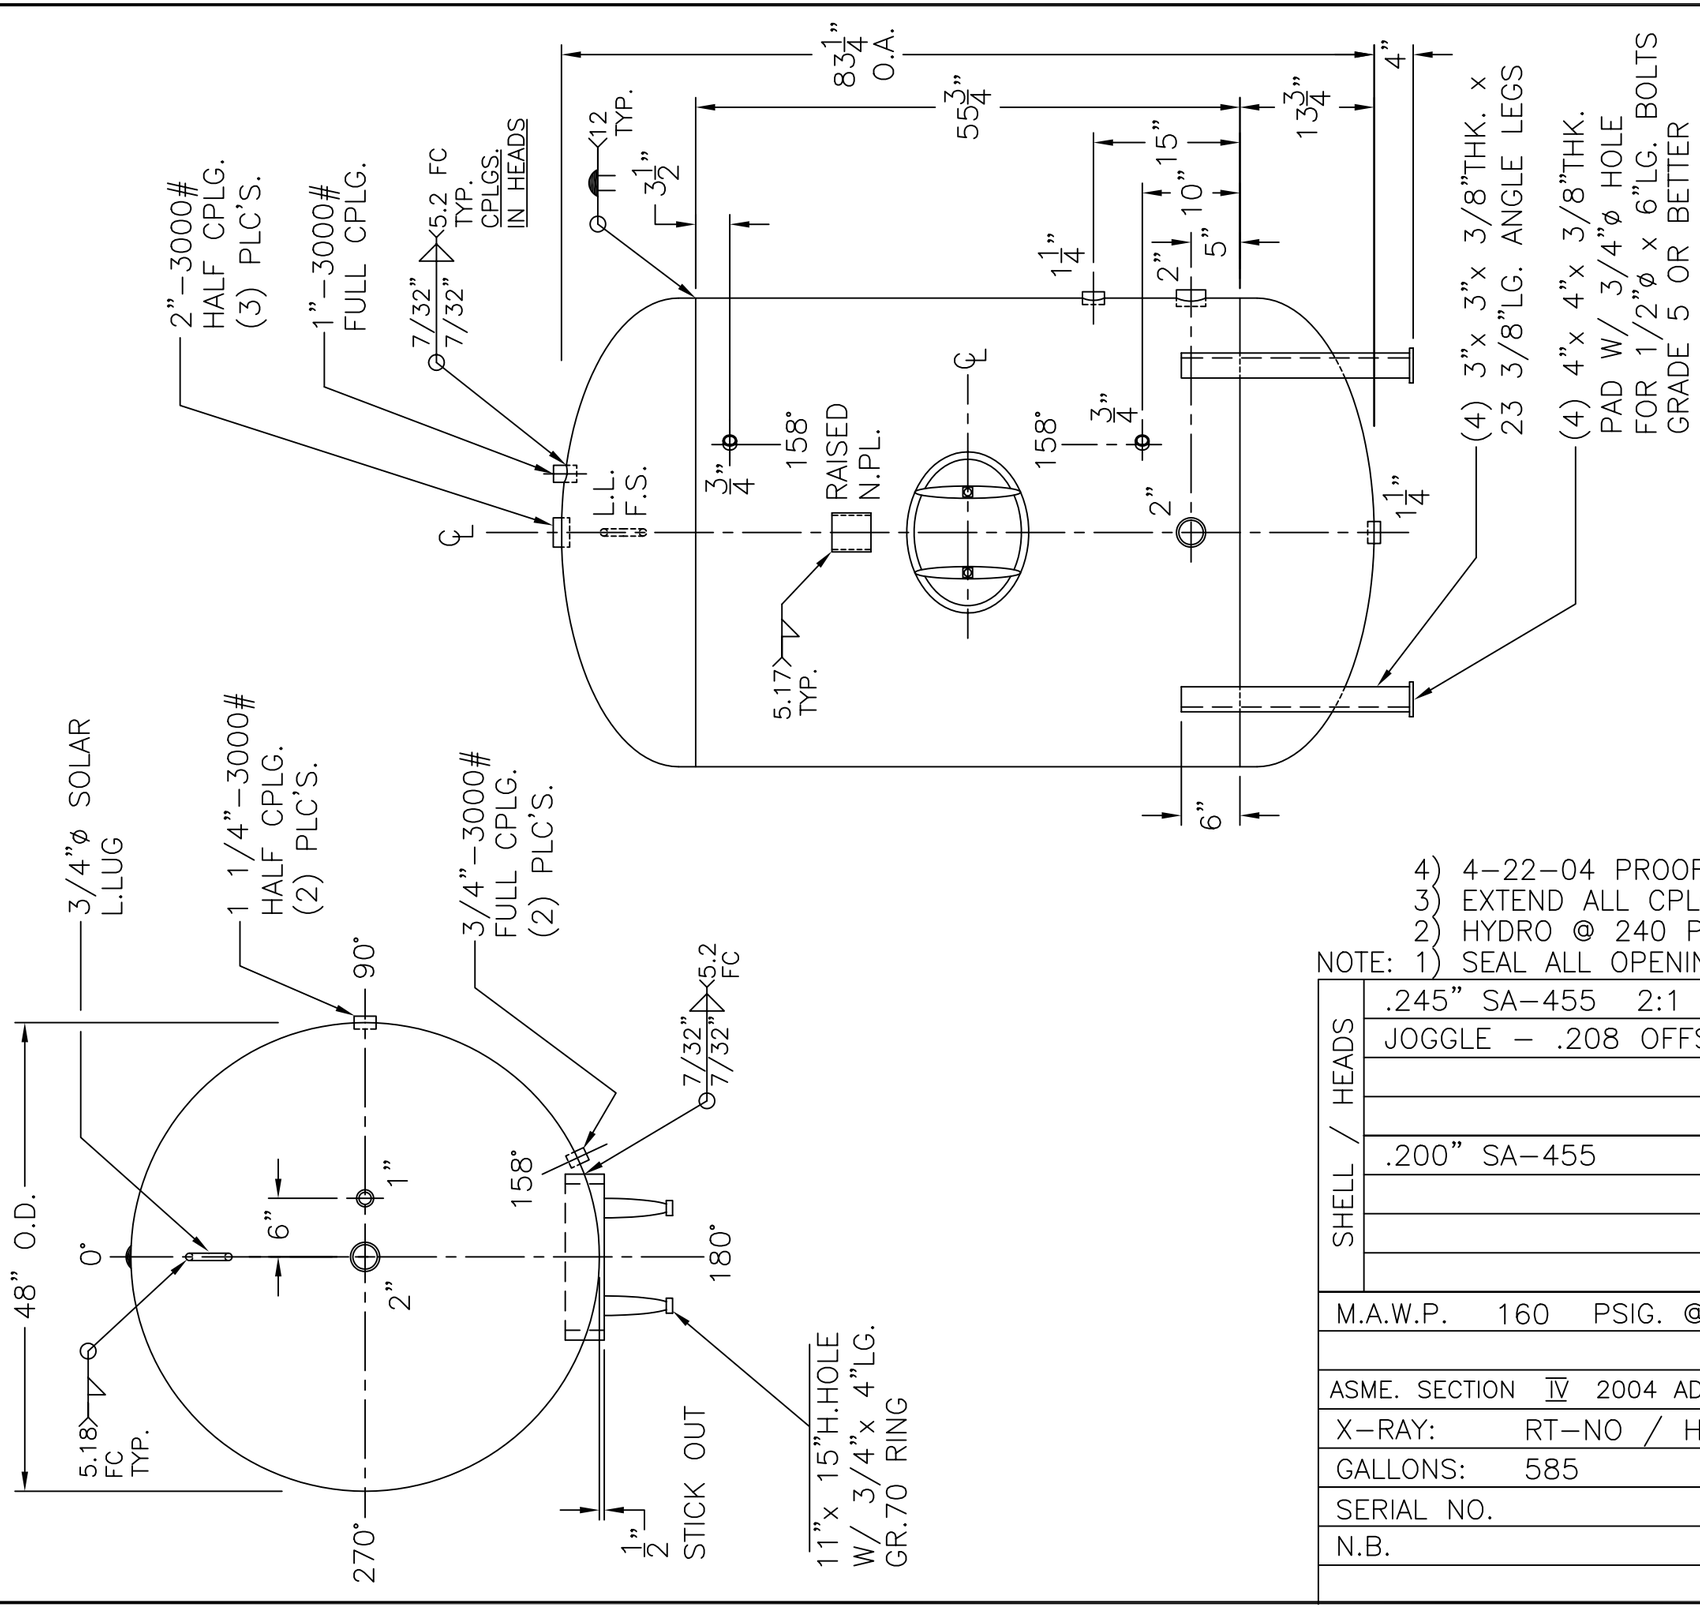

4) 4–22–04 PROOF TEST.
3) EXTEND ALL CPLGS. 5/8" INSIDE.
2) HYDRO @ 240 PSIG.
NOTE: 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.

SHELL / HEADS	.245" SA–455 2:1 S.E.	CS–48–585–V	REV. 1–22–07
	JOGGLE – .208 OFFSET		DATE: 12–9–97
		FOR: HANSON STANDARD	
		VERT. HOT WATER TANK.	
	.200" SA–455	94.5 SQ. FT. SURFACE AREA. THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT.	
M.A.W.P. 160 PSIG. @ 210 °F		INSIDE: CEMENT LINED	
		OUTSIDE: PRIME	
ASME. SECTION IV 2004 ADD. 2006		(556)	LEG–ZONE 4–15 KM.
X–RAY: RT–NO / H.L.W.		CAD–"B" UNDER "STD"–SERIES	
GALLONS: 585	WT. 1695 LBS.	BY: J.G.	SCALE: 3/4" =1'
SERIAL NO.		ROY E. HANSON JR. MFG.	
N.B.		1600 E. WASHINGTON BLVD. LOS ANGELES, CA 90021	