


NOTE: 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.
 2) HYDRO @ 225 PSIG. MIN. TO 235 PSIG. MAX.
 3) EXTEND ALL CPLGS. 5/8" INSIDE.
 4) 8-26-04 PROOF TEST.

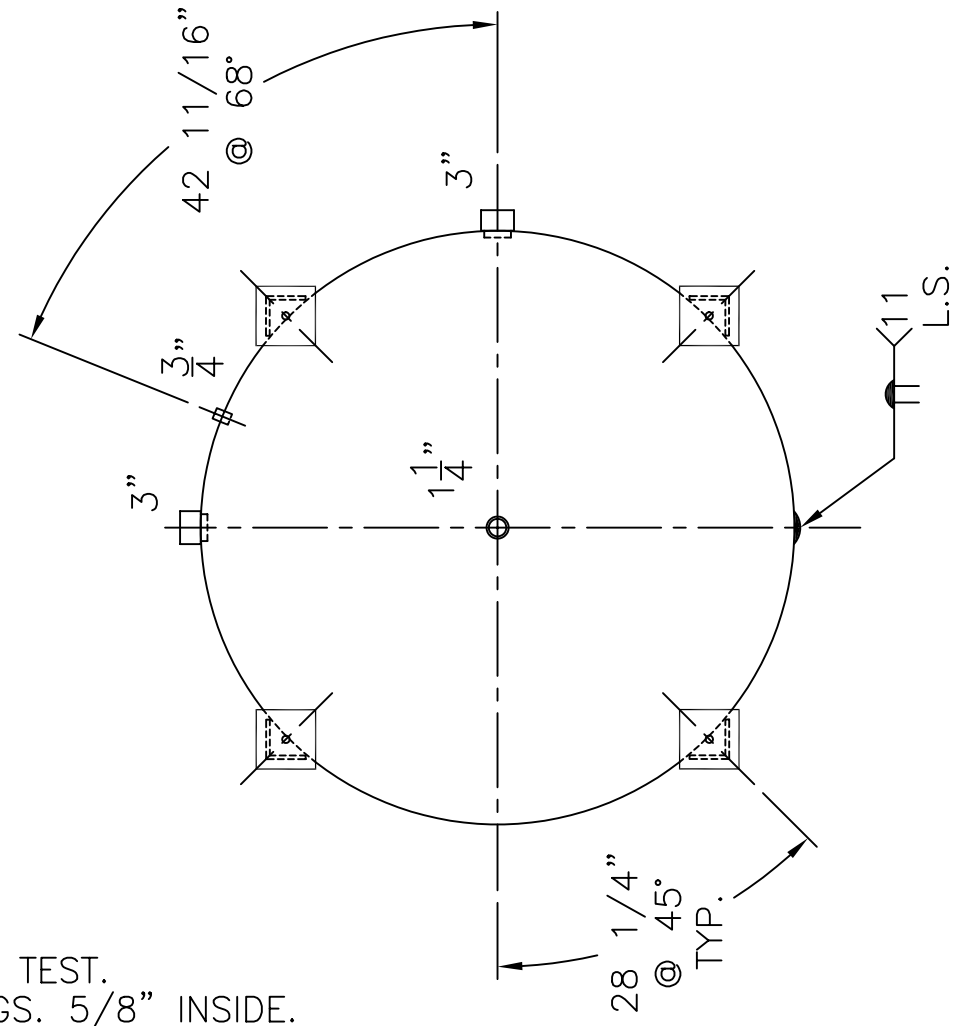

HEADS	.280" SA-455 2:1 S.E.	
	(.210" MIN.)	
SHELL	.248" SA-455	
M.A.W.P.	150 PSIG. @ 210 °F	
ASME SECTION	IV 2001 ADD. 2003	
X-RAY:	RT-NO / H.L.W.	
GALLONS:	1950	WT. 4205 LBS.
SERIAL NO.		
N.B.		

CS-72-1950-V	REV. 9-9-04
	DATE: 3-27-03
FOR: HANSON STANDARD VERT. WATER TANK	
213.3 SQ. FT. SURFACE AREA. THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT.	
INSIDE: CEMENT LINED	
OUTSIDE: PRIME	
(1874) LEG-ZONE 4-15 KM.	
CAD-"B" UNDER "STD"-SERIES	
BY: E.S.	SCALE: 1/2"=12"
ROY E. HANSON JR. MFG.	
1924 COMPTON AVE. LOS ANGELES, CA 90011	